


**NOTE:**

- NOTES:
1. AIR TERMINAL SHALL COVERED 45 DEGREE OF THE AREA FROM TOP OF TERMINAL
  2. IN ORDER TO REDUCE EARTHING RESISTANCE READING BELOW 5 Ohm, UTILISATION OF COMPOUND AS A MEDIUM IS ACCEPTABLE.

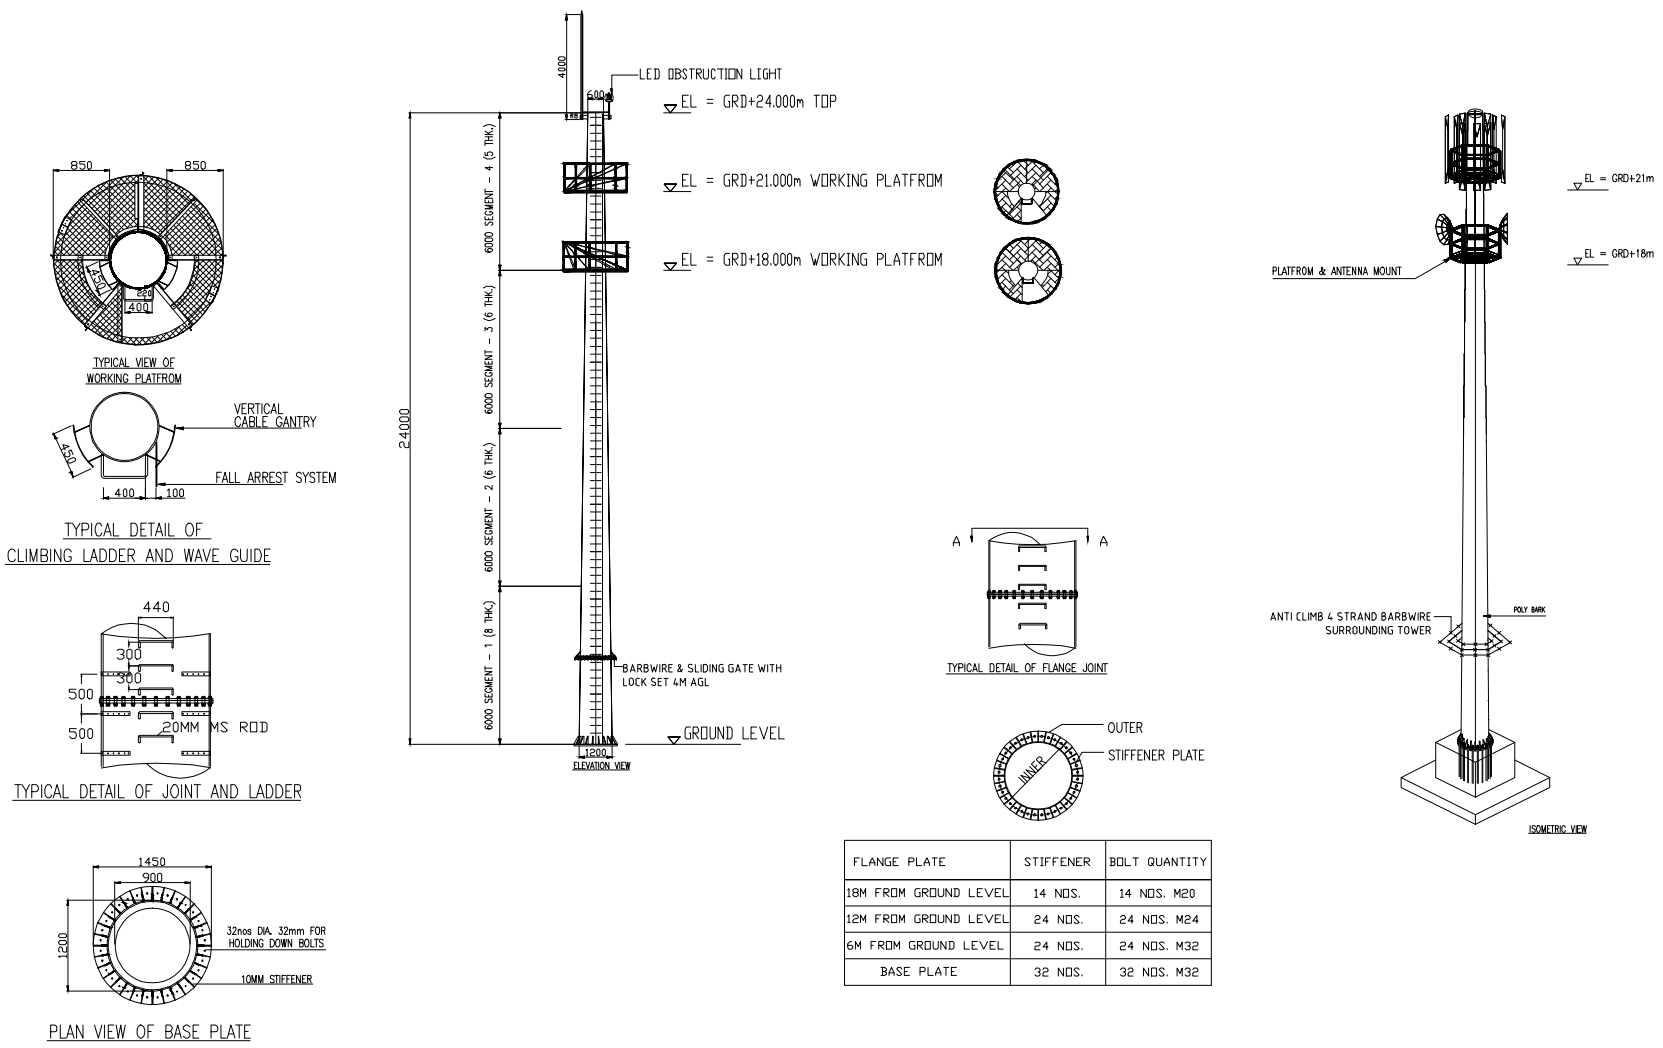

FLANGE PLATE	STIFFENER	BOLT QUANTITY
18M FROM GROUND LEVEL	14 NDS.	14 NDS. M20
12M FROM GROUND LEVEL	24 NDS.	24 NDS. M24
6M FROM GROUND LEVEL	24 NDS.	24 NDS. M32
BASE PLATE	32 NDS.	32 NDS. M32

INVITATION REFERENCE NO:  
MCMC/RDD/PDD(4)/T3\_Extn(P2)/  
TCA/12/14(12)

**PROJECT TITLE:**  
  
TIME 3 - EXTENSION  
(24M MONOPOLE - SPOKE SITE)

**DRAWING TITLE:**  
  
DRAWING 3:  
PLAN AND SECTIONS DETAILS